


Example of useful AHU BACnet

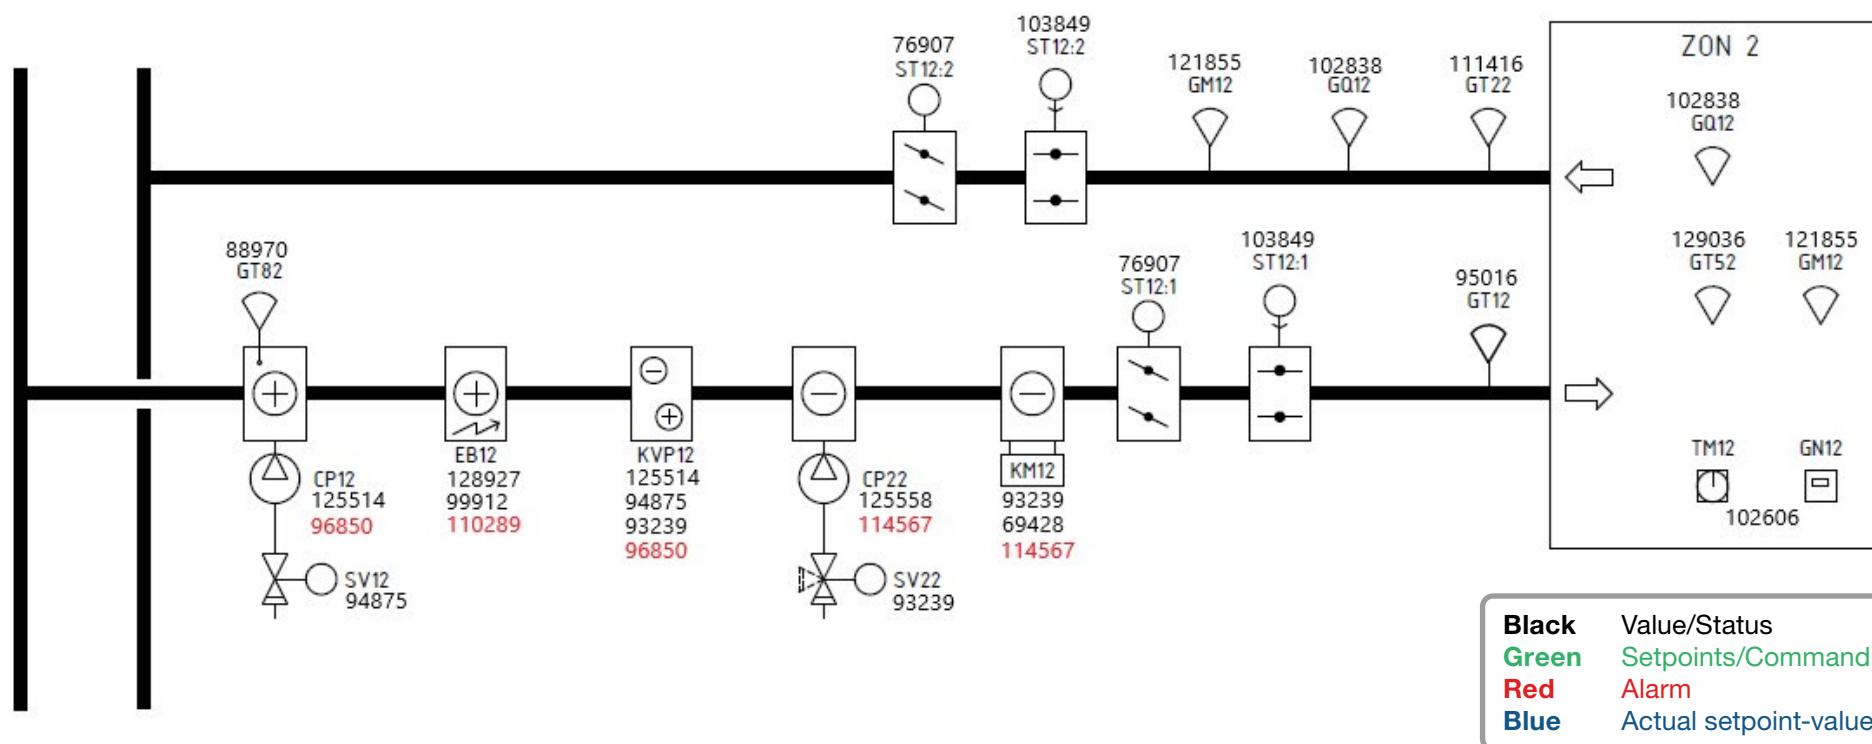

ZON 2		Z2	GT52	129036	Z2	Room temp	EB12	110289	Z2	El heating alarm	
Only when cascade {	109796	Z2	Temp setpoint	GQ12	102838	Z2	Air quality	SV22	93239	Z2	Cooling output signal
	125465	Z2	Temp deadzone	GQ12	73943	Z2	Air quality setpoint	CP22	125558	Z2	Cooling pump command
	127334	Z2	Temp current supply setpoint heating	GM12	121855	Z2	Humidity	CP22	114567	Z2	Cooling pump alarm
	101197	Z2	Temp current supply setpoint cooling	GM12	166425	Z2	Humidity setpoint	KM12	69428	Z2	DX cooling command
	101968	Z2	Temp current setpoint heating	SV12	94875	Z2	Heating output signal	KM12	114567	Z2	DX cooling alarm
	128123	Z2	Temp current setpoint cooling	CP12	125514	Z2	Heating pump command	ST12:X	76907	Z2	Damper output signal
	GT12	95016	Z2	Supply temp	CP12	96850	Z2	Heating pump alarm	ST12:X	103849	Z2
GT22	111416	Z2	Extract temp	EB12	128927	Z2	El heating output signal	TM1/GN12	102606	Z2	External control input
GT82	88970	Z2	Frost temp	EB12	99912	Z2	El heating command				