


Example of useful AHU BACnet

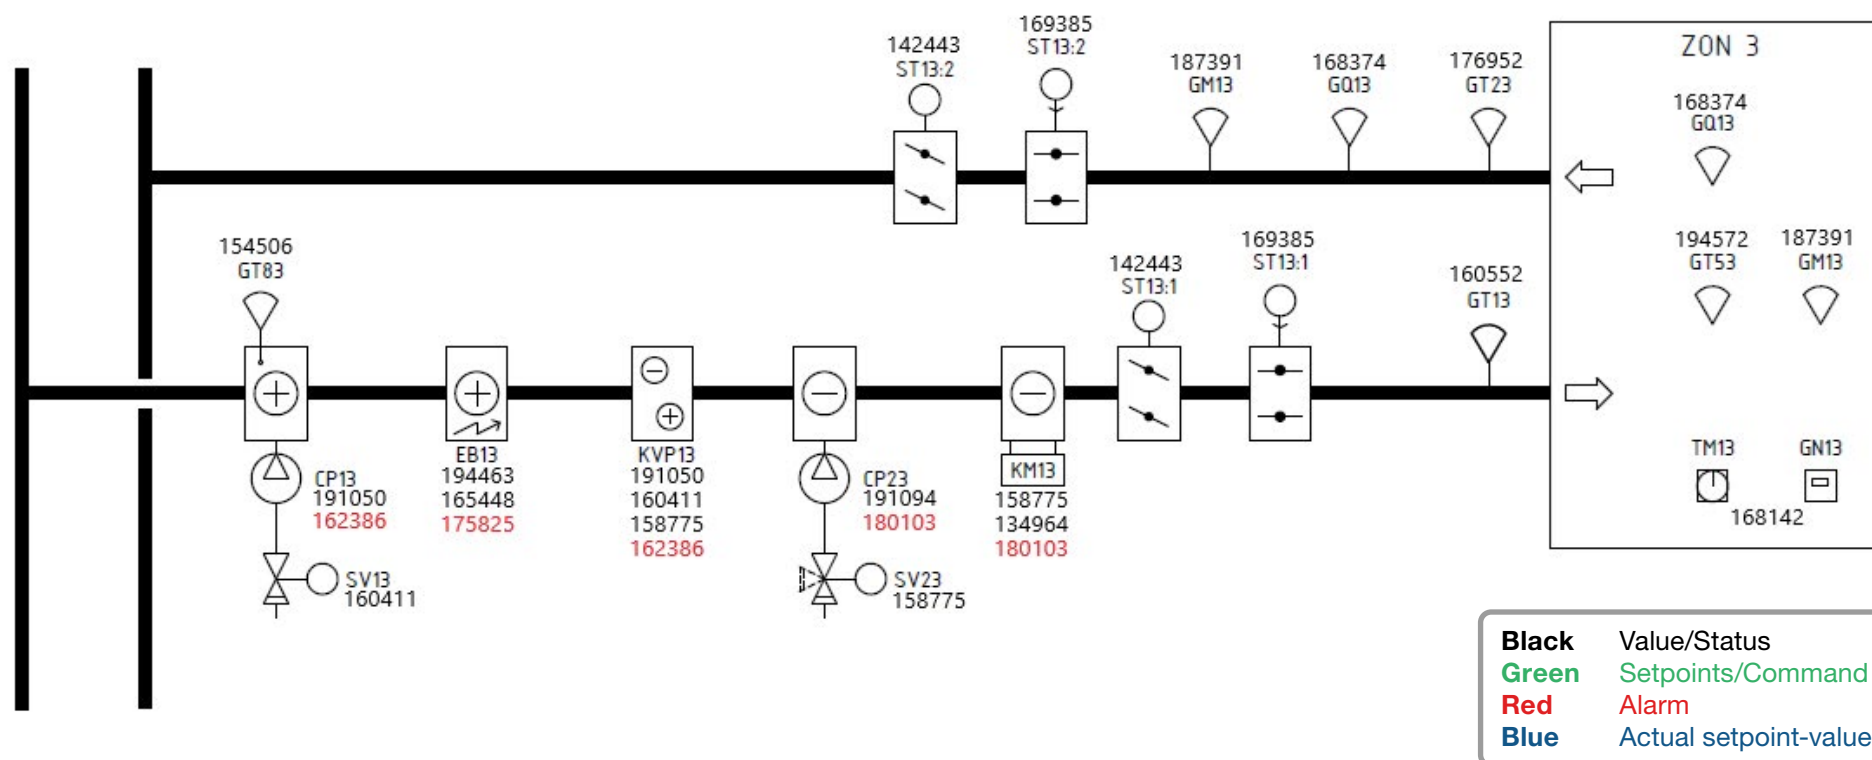

ZON 3		Z3	GT53	194572	Z3	Room temp	EB13	175825	Z3	El heating alarm		
Only when cascade	{	175332	Z3	Temp setpoint	GQ13	168374	Z3	Air quality	SV23	158775	Z3	Cooling output signal
		191001	Z3	Temp deadzone	GQ13	139479	Z3	Air quality setpoint	CP23	191094	Z3	Cooling pump command
		192870	Z3	Temp current supply setpoint heating	GM13	187391	Z3	Humidity	CP23	180103	Z3	Cooling pump alarm
		166733	Z3	Temp current supply setpoint cooling	GM13	231961	Z3	Humidity setpoint	KM13	134964	Z3	DX cooling command
		167504	Z3	Temp current setpoint heating	SV13	160411	Z3	Heating output signal	KM13	180103	Z3	DX cooling alarm
		193659	Z3	Temp current setpoint cooling	CP13	191050	Z3	Heating pump command	ST13:X	142443	Z3	Damper output signal
		GT13	160552	Z3	Supply temp	CP13	162386	Z3	Heating pump alarm	ST13:X	169385	Z3
GT23	176952	Z3	Extract temp	EB13	194463	Z3	El heating output signal	TM1/GN13	168142	Z3	External control input	
GT83	154506	Z3	Frost temp	EB13	165448	Z3	El heating command					