


Example of useful AHU BACnet

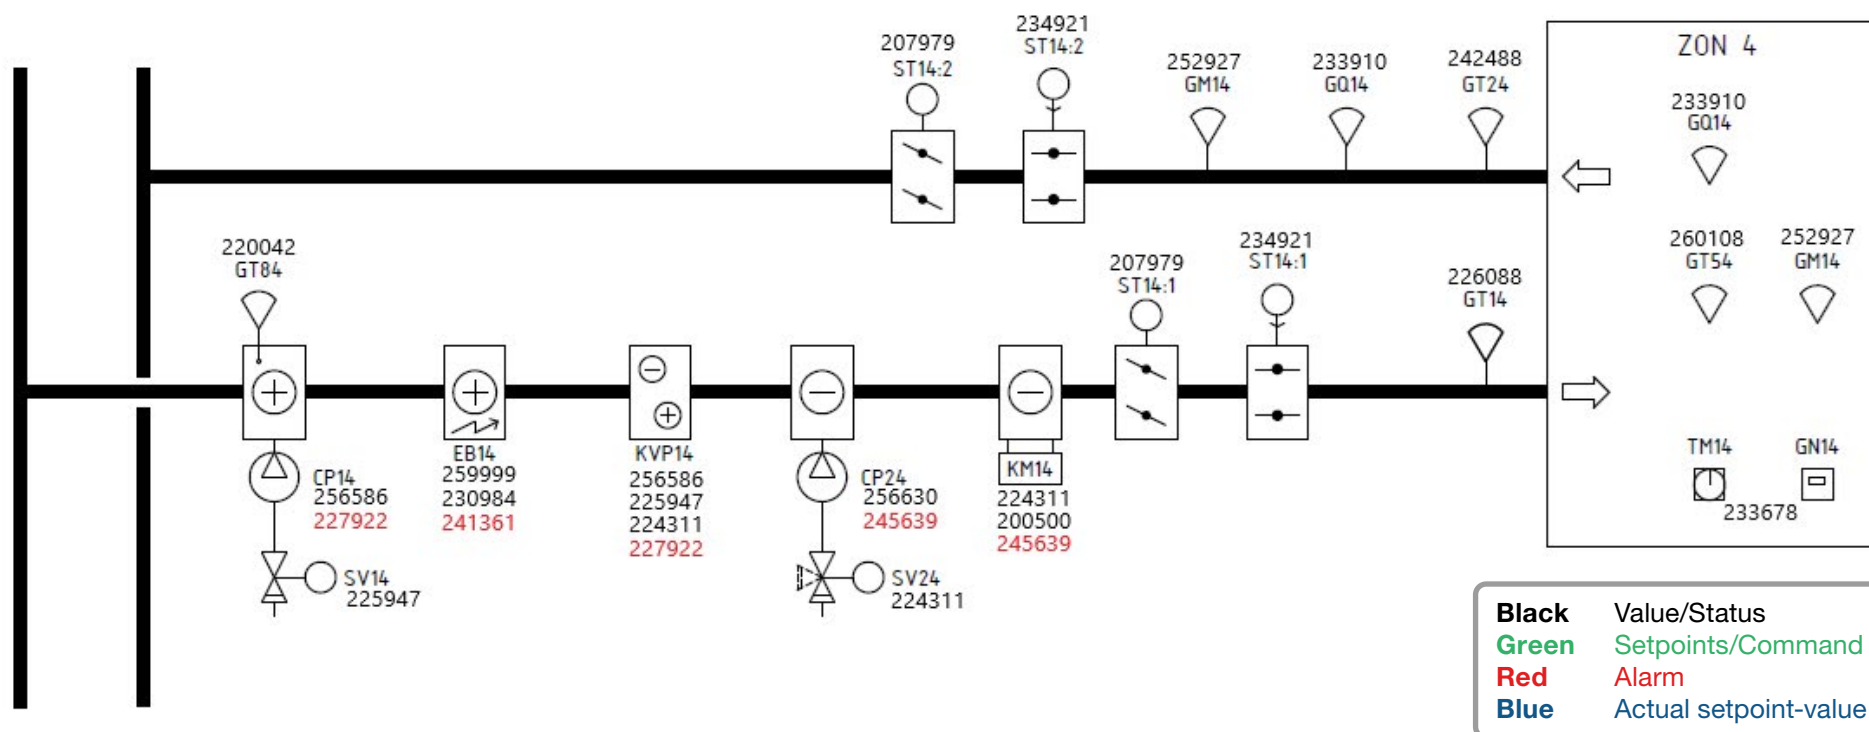

Only when cascade	ZON 4	Z4		GT54	260108	Z4	Room temp	EB14	241361	Z4	El heating alarm	
		240868	Z4	Temp setpoint	GQ14	233910	Z4	Air quality	SV24	224311	Z4	Cooling output signal
		256537	Z4	Temp deadzone	GQ14	205015	Z4	Air quality setpoint	CP24	256630	Z4	Cooling pump command
		258406	Z4	Temp current supply setpoint heating	GM14	252927	Z4	Humidity	CP24	245639	Z4	Cooling pump alarm
		232269	Z4	Temp current supply setpoint cooling	GM14	297497	Z4	Humidity setpoint	KM14	200500	Z4	DX cooling command
		233040	Z4	Temp current setpoint heating	SV14	225947	Z4	Heating output signal	KM14	245639	Z4	DX cooling alarm
		259195	Z4	Temp current setpoint cooling	CP14	256586	Z4	Heating pump command	ST14:X	207979	Z4	Damper output signal
		GT14	226088	Z4	Supply temp	CP14	227922	Z4	Heating pump alarm	ST14:X	234921	Z4
	GT24	242488	Z4	Extract temp	EB14	259999	Z4	El heating output signal	TM1/GN14	233678	Z4	External control input
	GT84	220042	Z4	Frost temp	EB14	230984	Z4	El heating command				