


Example of useful AHU BACnet

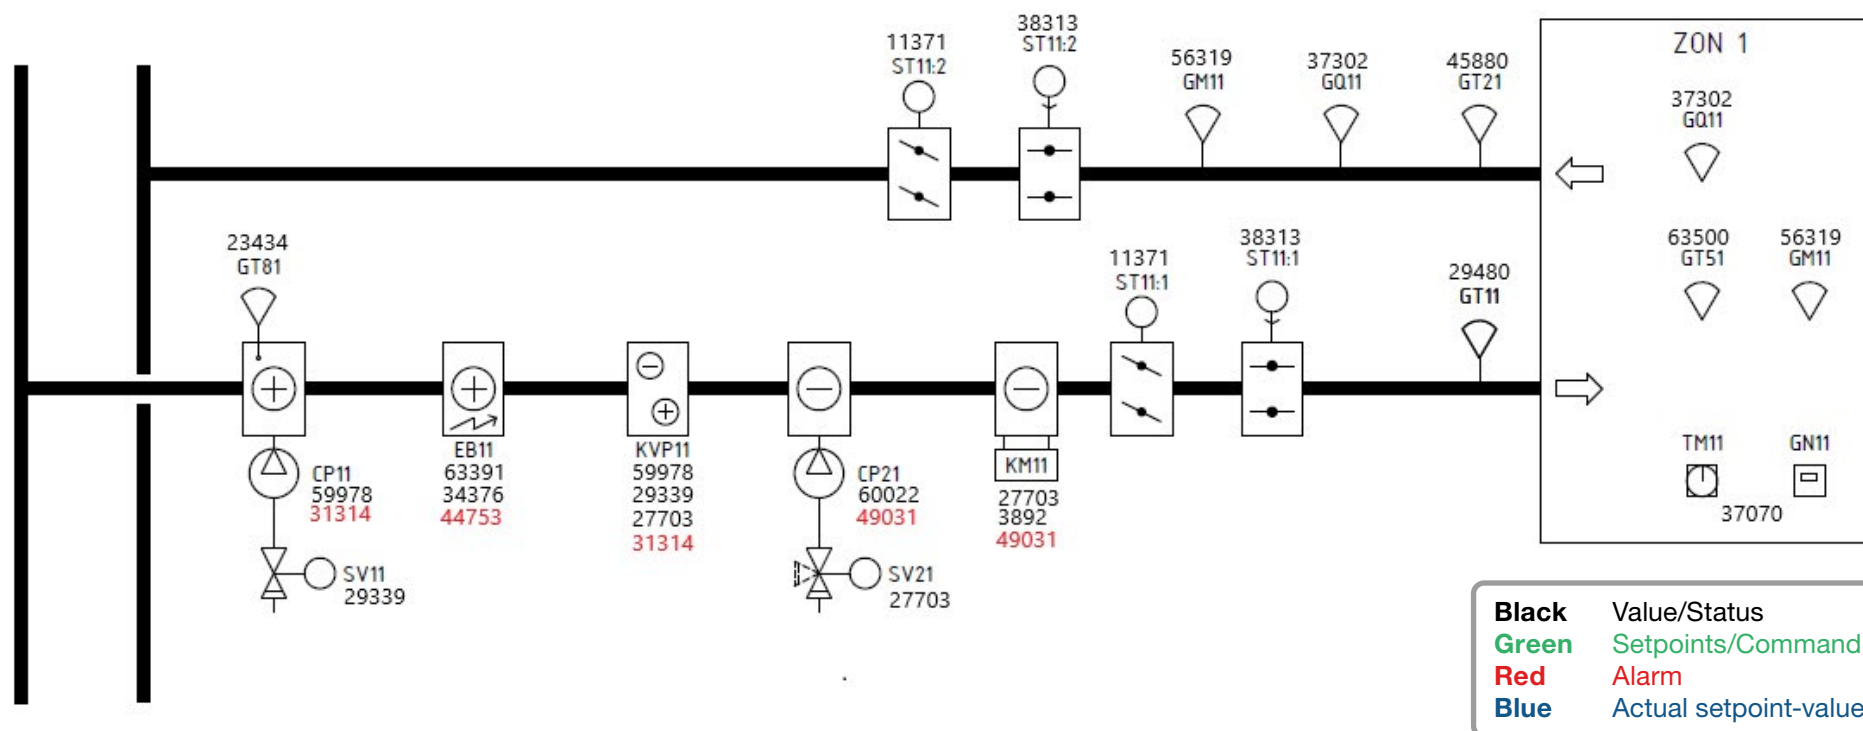

ZON 1	Only when cascade	44260	Z1	Temp setpoint	GT51	63500	Z1	Room temp	EB11	44753	Z1	El heating alarm
		59929	Z1	Temp deadzone	GQ11	37302	Z1	Air quality	SV21	27703	Z1	Cooling output signal
		61798	Z1	Temp current supply setpoint heating	GQ11	8407	Z1	Air quality setpoint	CP21	60022	Z1	Cooling pump command
		35661	Z1	Temp current supply setpoint cooling	GM11	56319	Z1	Humidity	CP21	49031	Z1	Cooling pump alarm
		36432	Z1	Temp current setpoint heating	GM11	100889	Z1	Humidity setpoint	KM11	3892	Z1	DX cooling command
GT11		62587	Z1	Temp current setpoint cooling	SV11	29339	Z1	Heating output signal	KM11	49031	Z1	DX cooling alarm
		29480	Z1	Supply temp	CP11	59978	Z1	Heating pump command	ST11:X	11371	Z1	Damper output signal
		45880	Z1	Extract temp	CP11	31314	Z1	Heating pump alarm	ST11:X	38313	Z1	Damper command
		23434	Z1	Frost temp	EB11	63391	Z1	El heating output signal	TM1/GN11	37070	Z1	External control input
					EB11	34376	Z1	El heating command				