


STD-18 PREHEATING

Artikelnummer	Förvärme
STD-18-1	Preheating in sequence (water)
STD-18-2	Preheating individual temp.control (water)
STD-18-3	Preheating in sequence (electric)
STD-18-4	Preheating individual temp.control (electric)
STD-18-5	Combi-coil preheating/precooling

Preheating in sequence

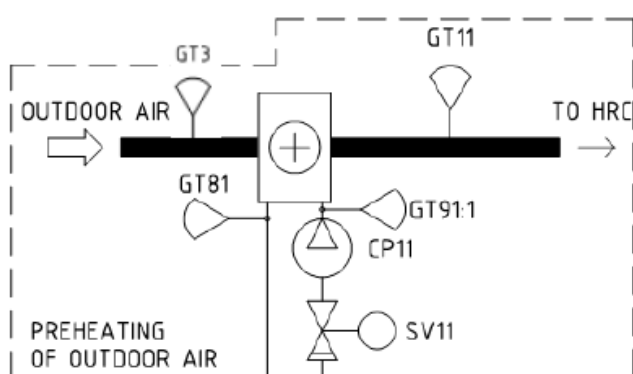


Temperature control in sequence. Heating demand activates, in the following order:

Heat recovery -> Preheating -> Other heating

Temperature sensor after preheater (GT11) only used for monitoring.

Preheating is blocked if water supply temperature (GT91:1) is below outside air temperature (GT3).

Preheating/precooling in sequence (Combi-coil)

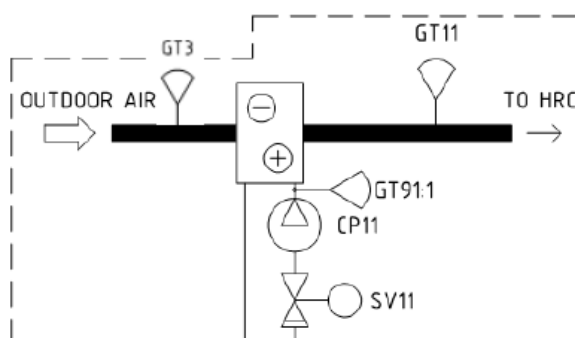

Temperature control in sequence. Heating demand activates, in the following order:

Heat recovery -> Preheating -> Other heating


Cooling demand activates, in the following order:

Fan cooling -> Precooling -> Other cooling

Temperature sensor after preheater/cooler (GT11) only used for monitoring.

Preheating is blocked if water supply temperature (GT91:1) is below outside air temperature (GT3).

Preheating individual temp.control

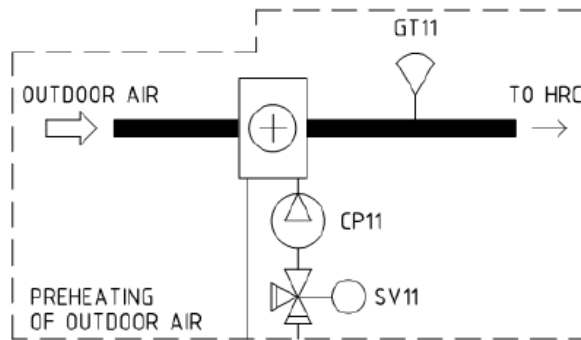

Temperature is controlled to a separate setpoint via temperature sensor after preheater (GT11).

Not in heating sequence with heat recovery or other heating.